THIS DOCUMENT IS CONFIDENTIAL AND SHOULD NOT BE DISCLOSED TO THIRD PARTIES

The timer should operate in accordance with the appropriate electrical circuit and sequence chart as per ELBI drawings.
No changes and/or modifications are allowed without prior notification and approval by ELBI engeneering department

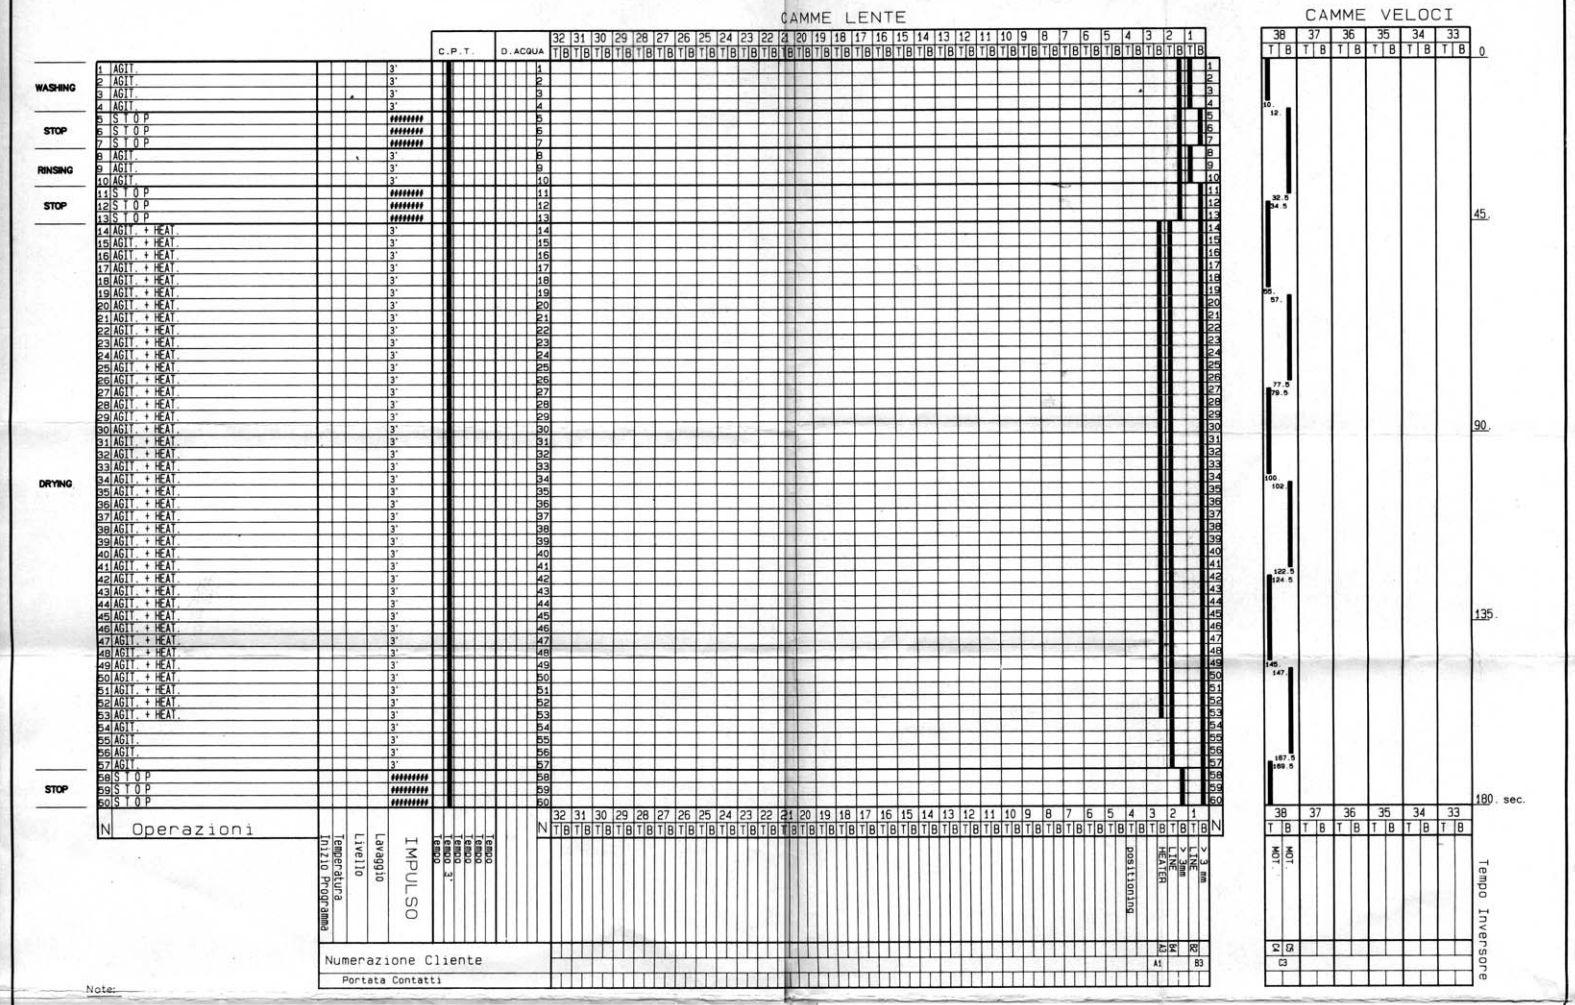

Note:

- STEP TIME 50 HZ = 3'
- STEP TIME 60 HZ = 2.5'

○ ELBI track numeration

□ CASTOMER numeration



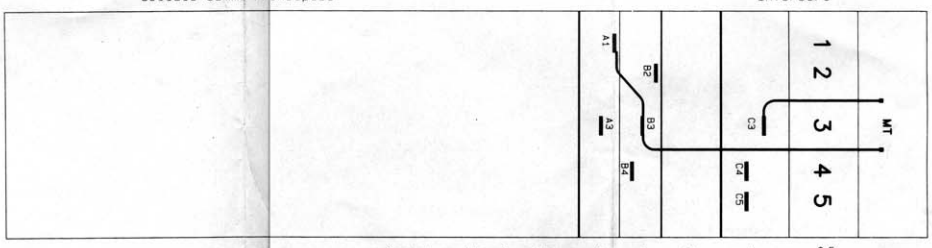

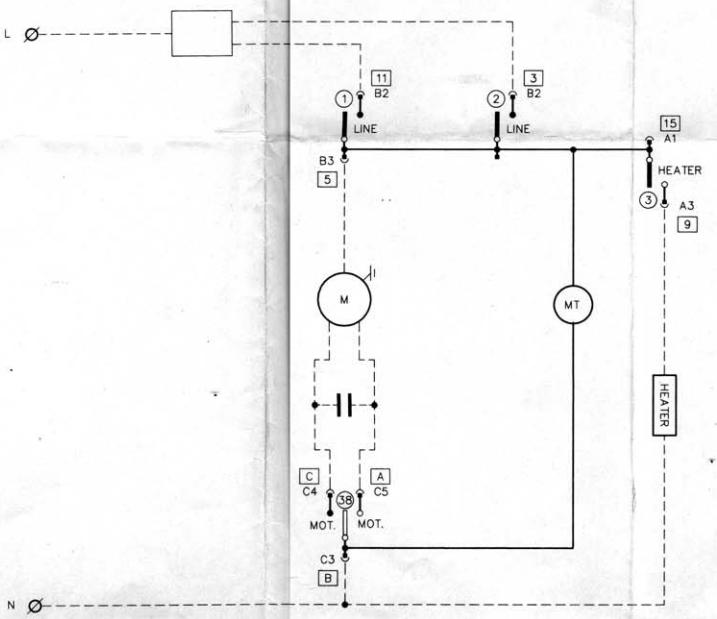

elbi INTERNATIONAL S.P.A.

LINEAGRAMMA - SCHEMA ELETTRICO
Sequence Chart - Circuit Diagram
Cliente: CARAD INDUSTRIAL
Customer:

Disegno Nr.
Drawing Nr. D 0802/0/00

Modif	Descrizione	Data	Disegnato
P1	NEW SAMPLE (1996/98)	20/11/97	FLORIAN M.
00	P1 -> SERIE (0032/98)	13/01/98	FLORIAN M.

Data: 20/11/97
Disegnato: FLORIAN M.
Sost.:
Sost. con:
Visto: VICH A.